



SPHERE Assembly and Operation Demonstration

December 2020



*INL is a U.S. Department of Energy National Laboratory
operated by Batelle Energy Alliance, LLC*

DISCLAIMER

This information was prepared as an account of work sponsored by an agency of the U.S. Government. Neither the U.S. Government nor any agency thereof, nor any of their employees, makes any warranty, expressed or implied, or assumes any legal liability or responsibility for the accuracy, completeness, or usefulness, of any information, apparatus, product, or process disclosed, or represents that its use would not infringe privately owned rights. References herein to any specific commercial product, process, or service by trade name, trade mark, manufacturer, or otherwise, does not necessarily constitute or imply its endorsement, recommendation, or favoring by the U.S. Government or any agency thereof. The views and opinions of authors expressed herein do not necessarily state or reflect those of the U.S. Government or any agency thereof.

SPHERE Assembly and Operation Demonstration

Piyush Sabharwall
Jeremy Hartvigsen
Terry Morton
Zach Sellers
Jun Soo Yoo

December 2020

Idaho National Laboratory
Originating Organization
Idaho Falls, Idaho 83415

<http://www.inl.gov>

Prepared for the
U.S. Department of Energy
Office of NE
Under DOE Idaho Operations Office
Contract DE-AC07-05ID14517

Page intentionally left blank

SUMMARY

The objective of the current scope was to complete single primary heat extraction and removal emulator (SPHERE) assembly and demonstrate the operation of the SPHERE facility. The initial testing consisted of vacuum operation of a sodium heat pipe. The temperature was measured at 10 evenly spaced points along the heat pipe. Additional exterior thermocouple measurements were also taken on the exterior of the heat pipe to confirm the similarity of thermowell temperatures to exterior heat pipe temperature measurements. The initial test was successfully completed and results measured at INL are consistent with the data from the manufacturer.

Page intentionally left blank

CONTENTS

1.	SPHERE Assembly and Operation Demonstration	1
1.1	Introduction.....	1
1.2	Experimental Setup.....	1
1.3	Experimental Test Results	3

FIGURES

Figure 1:	Heat Pipe Thermal Couple Measurement Points	1
Figure 2:	Heat Pipe Exterior Instrumentation.....	1
Figure 3:	Cross-section geometry of a seven-hole core block for the single heat pipe experiment (6 in., 1/2 m, 1 m), not to scale.....	2
Figure 4:	SPHERE test bed and seven-hole test article.....	3
Figure 5:	Optical image of heater test and initial short-heat pipe operation.....	4
Figure 6:	Data from INL testing of ACT heat pipe	4
Figure 7:	Manufacturer test data.....	5

TABLES

Table 1:	SPHERE Test Plan for Shakedown Testing.....	3
Table 2:	Table of Instrumentation used in shakedown testing	5

Page intentionally left blank

1. SPHERE Assembly and Operation Demonstration

1.1 Introduction

Single primary heat extraction and removal emulator (SPHERE) facility and capability is designed and being developed to support non-nuclear thermal and integrated systems testing, for better understanding of thermal performance of the heat pipe under a wide range of heating values and operating temperatures, further enhancing understanding of heat pipe startup and transient operation. As more progress is made the experimental group will be performing calorimetric measurements with water-cooled gas-gap calorimeter, determining heat-pipe operational limits, and testing under both air and inert gas conditions.

1.2 Experimental Setup

The initial test article is a heat pipe supplied by Advanced Cooling Technologies (ACT). The heat pipe has a centerline thermowell for the vapor region. A multi-point thermocouple from Idaho labs was inserted into the thermowell as shown in Figure 1.

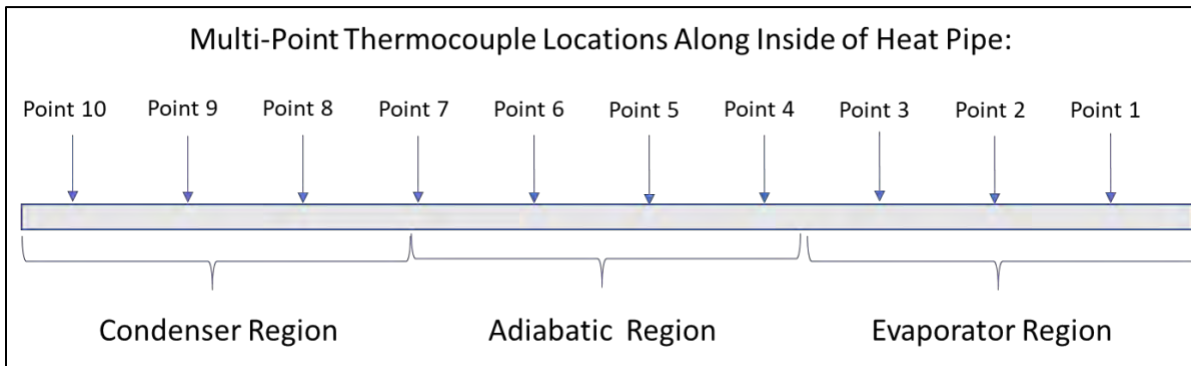


Figure 1: Heat Pipe Thermocouple Measurement Points

Exterior thermocouples were strapped down using .005” stainless steel straps made from shim stock. The locations of these thermocouples are shown in Figure 2.

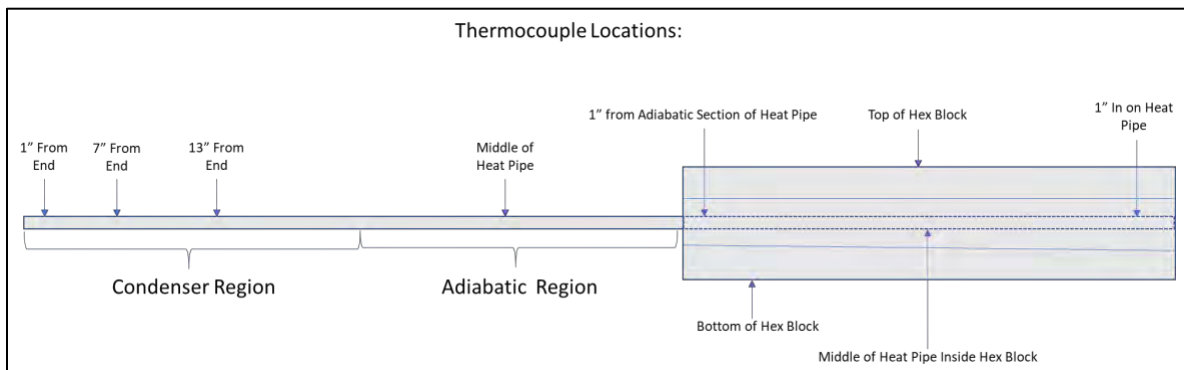


Figure 2: Heat Pipe Exterior Instrumentation

Heater power control is achieved using Watlow Din-A-Mite silicon-controlled-rectifier (SCR)-based power controllers, based on a 4–20 mA control signal provided from the National Instruments SCXI data-acquisition system, which is interfaced to a LabVIEW virtual instrument for data acquisition and instrument control. Pressure inside the heat pipes will be sub-atmospheric even at the highest operating temperature, so any failure of the heat pipe would not involve a pressurized release of material. Power to each heater is monitored continuously using precision power meters designed for measurement of SCR-controlled loads. The design basis heat-flux value for the cartridge heaters is 3.8 W/cm^2 , based on expected microreactor-core power densities. For the 1 m block, each heater would operate at 2 kW for a total power of 12 kW with linear interpolations between the two. The cross-section geometry of different core block is shown in Figure 3. Heat-pipe operating temperatures will be limited to 750°C .

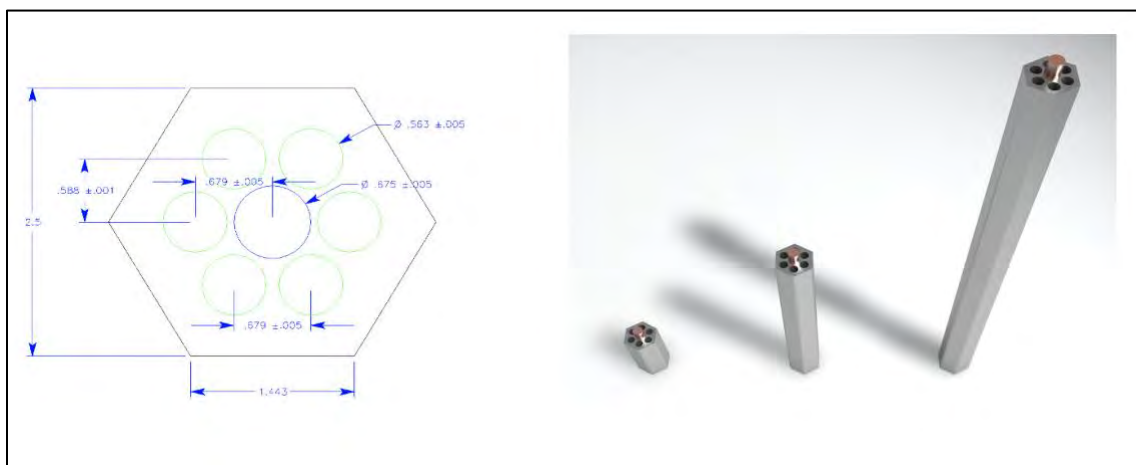


Figure 3: Cross-section geometry of a seven-hole core block for the single heat pipe experiment (6 in., 1/2 m, 1 m), not to scale.

The SPHERE test bed experimental setup is shown in Figure 2. The characteristics of the test bed are as follows:

Test chamber characteristics include:

- Vacuum (10^{-4} torr) or inert gas
- 8 ft long \times 6 in. diameter quartz tube
- Flanges for gas flow connections and instrumentation feedthrough ports

Electrical heating capability requires:

- A test bed designed for up to 20 kW electrical power to heaters
- Maximum test article temperature of 750°C
- Heat rejection through passive radiation or coupled with a water-cooled gas gap calorimeter.



Figure 4: SPHERE test bed and seven-hole test article.

The objectives and procedure are outlined for the shakedown test in Table 1.

Table 1: SPHERE Test Plan for Shakedown Testing

SPHERE TEST Plan					
		Conditions	Measurements	Instruments	Objective
SHAKEDOWN TEST					
1	100 °C/hour heat up to 650 °C operating temperature Hold for 2 hours	Vacuum	Temperature, heater power, IR Camera, Visual inspection, Oxygen content, Absolute pressure	Type K Thermocouples, Watt-Transducers, Pressure Gauge, IR- Camera	Heating and control check
	100 °C/hour cool down to sub 400 °C Passively cool to ambient				
	Observe material bonding quality				

1.3 Experimental Test Results

A preliminary evaluation of heater vacuum performance without exterior insulation was performed. Short distance heat pipe operation was observed as a secondary part of this heater testing. This is shown by the bare hex-block being heated under direct observation. The heat pipe and the heaters were both inserted in the block with centering wires and coated with boron nitride. The boron nitride provides a stable high temperature interface between with the hex-block and the heaters and heat pipe. Post examination of the hex-block showed some oxidation, but oxidation color did not correlate with normal open-air color of steel at the heat treatment temperature. The visible spectrum thermal radiation can be seen in Figure 5. After

performing this heater test, the system was then insulated in preparation for testing the heat pipe performance.

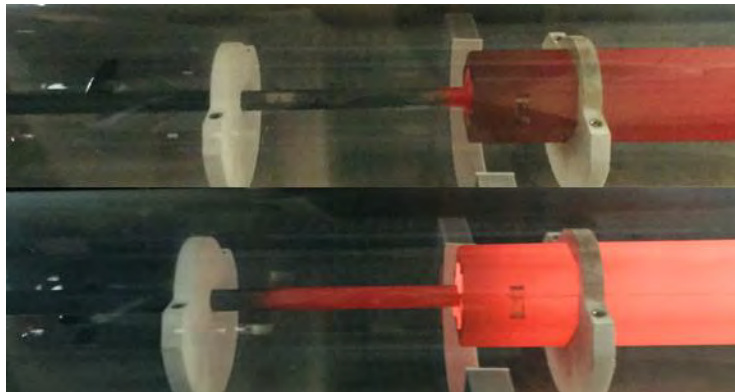


Figure 5: Optical image of heater test and initial short-heat pipe operation

The full shakedown testing used vacuum conditions as well as a 1-inch zirconia wool blanket (Zircar refractory insulation) for the hex-block and a zirconia wool sock (1/8") over adiabatic length of the heat pipe. The results of the preliminary testing are shown in Figure 6. The data from this shakedown test follows very closely with the manufacturer validation and characterization testing (Figure 7). The INL heat pipe shows overall stronger thermal coupling in the condenser section. This is consistent with ACT having blanketing on the condenser section, while the INL test left the condenser section bare.

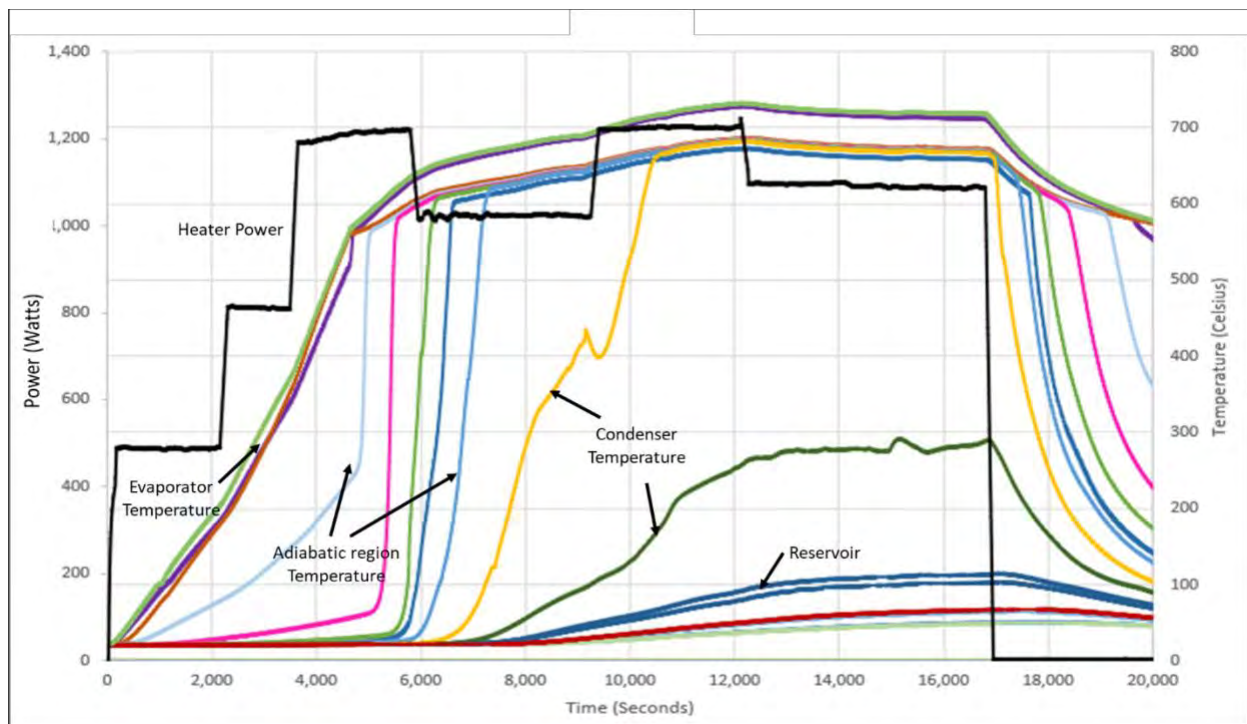


Figure 6: Data from INL testing of ACT heat pipe

The peak observed temperature in the hex-block was approximately 740 °C. The heat pipe operated at a nominal 650 °C. Without a calorimeter on the condenser end, calculation of the exact heat losses through to the surroundings through the adiabatic section and the exterior of the hex-block is difficult. Based on the similarity of temperature profiles to that of the manufacturer testing, an estimate of 500 W loss out of the 1200 W heat input is the initial observation. This agrees with initial heat loss calculations for estimating system performance. More detailed information on heat losses in the system will be available when the system is operated at full capability and a water-based differential temperature calorimeter is used with the condenser end.

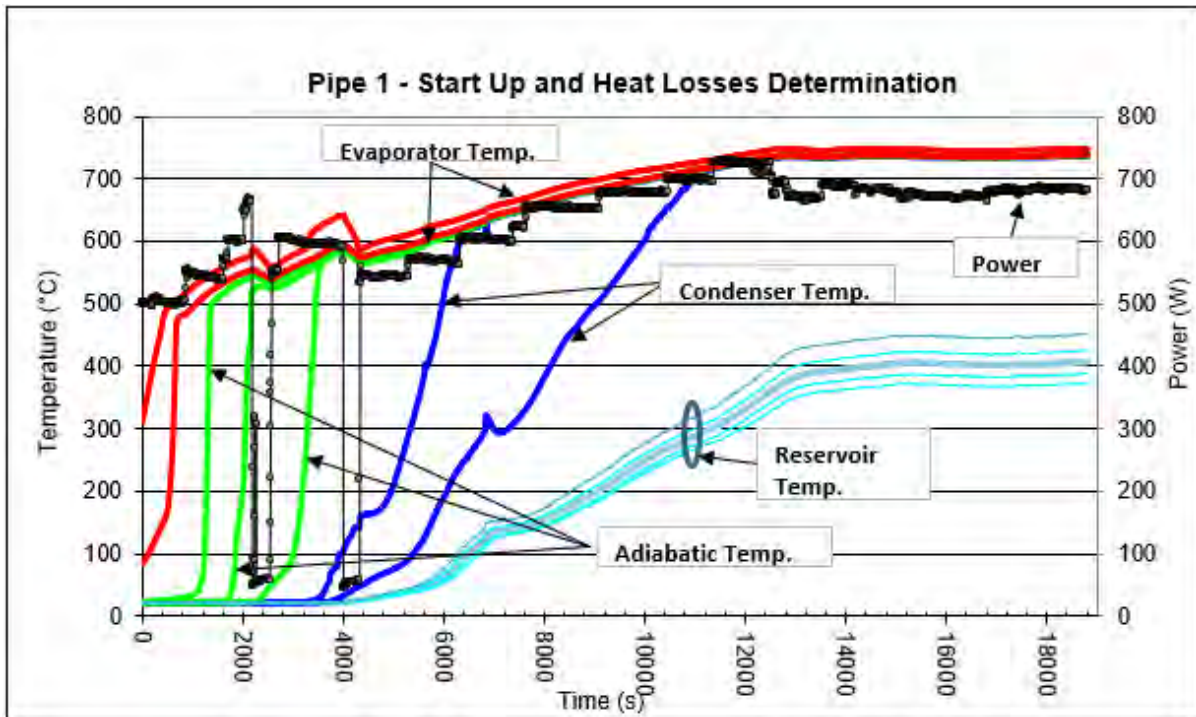


Figure 7: Manufacturer test data

A summary of the instrumentation is shown in Table 2. Further advanced instrumentation techniques will be implemented as part of ongoing performance testing and data needed to support verification and validation of NEAMs modeling and simulation tools.

Table 2: Table of Instrumentation used in shakedown testing

Instrumentation	Qty
m-TIM thermal Imaging Camera	1
Type-K thermocouple	8
Multi-point type-K thermocouple	1
Absolute pressure gauge	1

Conclusion

Single primary heat extraction and removal emulator (SPHERE) facility and capability is designed and being developed to support non-nuclear thermal and integrated systems testing, for better understanding of thermal performance of the heat pipe under a wide range of heating values and operating temperatures,

further enhancing understanding of heat pipe startup and transient operation. The initial testing consisted of vacuum operation of a sodium heat pipe. The temperature was measured at 10 evenly spaced points along the heat pipe. Additional exterior thermocouple measurements were also taken on the exterior of the heat pipe to confirm the similarity of thermowell temperatures to exterior heat pipe temperature measurements. The initial test were successfully completed and results measured at INL are consistent with the data from the manufacturer. In future, the experimental group will be performing calorimetric measurements with water-cooled gas-gap calorimeter, determining heat-pipe operational limits, and testing under both air and inert gas conditions.